


Technical Standard – Storm Lateral

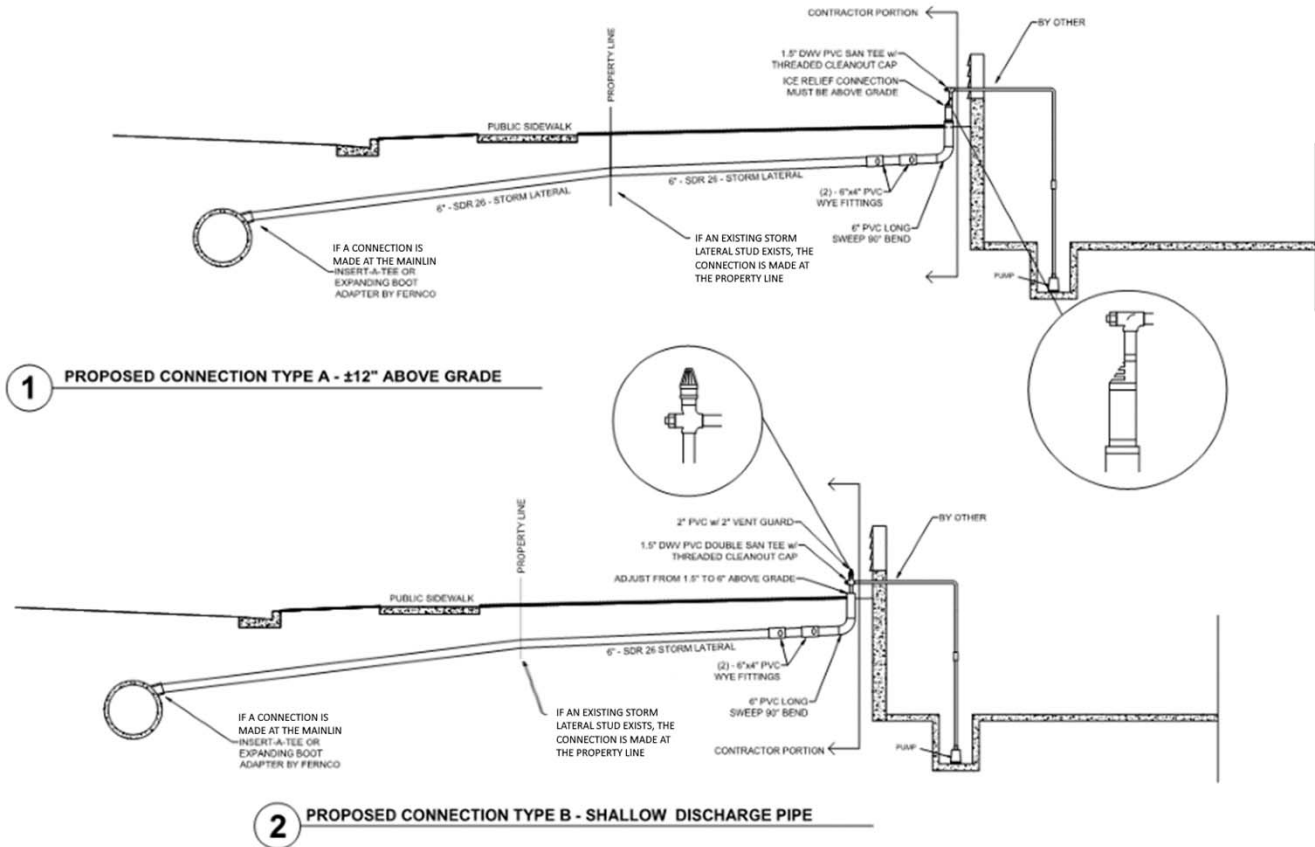

A storm lateral shall be installed only if:

- there is a storm lateral connection at the property line, and
- it is required by the municipality or it is desired by the property owner

The work shall include trenching and installing 6" diameter PVC pipe in accordance with the local municipality and State Plumbing Code from the storm lateral located at the property line to the sump pump discharge outside the basement wall. The contractor shall use appropriate adaptors to connect the 6" storm lateral extension to the existing storm lateral (size, location, and material to be confirmed with the municipality) and 1-1/2" diameter PVC sump pump discharge.

If connecting to an existing storm lateral, the contractor should complete a CCTV inspection to assure the storm lateral is in good working condition.